



WASHWALL O&M MANUAL


UPDATED AUGUST 2026

CONTENTS

3	WashWall Thermostatic Mixing Valve
10	WashWall Water Service Valves and Filters
11	WashWall Hand Dryer Unit
16	WashWall Soap Dispenser System
22	Cleaning the Compressor (Foam Dispensers)
23	Clean the Soap Tank
24	WashWall Tap Unit
28	WashWall Lighting Colour Control
29	WashWall Light Sensor Control
30	WashWall Light Sensor Board Inspection / Replacement / Temporary Repair / Over-Ride
31	WashWall Cleaner's Switch
32	WashWall Fuse Checking / Resetting
33	WashWall Control Screen Setting
34	WashWall Mirrors
36	WashWall Gas Struts
38	Commissioning Checklist
41	Graphic Overview: Inside the WashWall System

WASHWALL THERMOSTATIC MIXING VALVE

TECHNICAL DATA

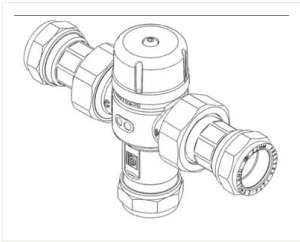

Operating Range	High Pressure	Low Pressure
Maximum static pressure - bar	10	10
Hot & cold flow pressure - bar	1.0 to 5	0.2 to 1
Hot supply temperature - °C	52 to 65	52 to 65
Cold supply temperature - °C	5 to 20	5 to 20

Minimum hot inlet to mixed outlet temperature differential = 10°C. Note: Valves operating outside these conditions can not be guaranteed by the Scheme to operate as Type 3 valves.

The highest flow rates will be achieved under balanced pressure conditions, but the pressure at the valve inlets must be within a ratio of 5:1 under flow conditions and the size and layout of pipework and fittings must take this into account.

IMPORTANT NOTE


Flush supply lines thoroughly before connecting Dolphin WashWall unit. Do not allow dirt, teflon tape or grease to enter TMV.

CONNECTION

Before connection, the system operating conditions of inlet pressures, hot water temperature and hot and cold water flow rates should be determined and confirmed to be within the expected conditions of normal use.

Valves must operate in either a high pressure setting or a low pressure setting; valves are not capable of operation with, for instance, hot water supply in one pressure range and cold water supply in the other pressure range. In these conditions it is necessary to either boost one pressure or reduce the other so that both supplies are within a common pressure range.

Correct location of the mixing valve is important to ensure that it is accessible for commissioning and servicing.

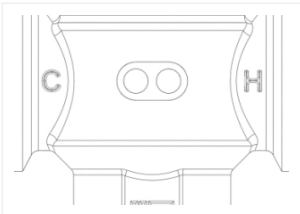

WASHWALL THERMOSTATIC MIXING VALVE

APPLICATION

The Dolphin WashWall TMV3 thermostatic mixing valve has been independently tested by WRc-NSF against the requirements of BS 7942:2000 and NHS D08 and certified as complying with the requirements of the TMV3 Scheme and is suitable for use in the designations shown in the table below.


Valves approved for designation for use 'HP' only: If a water supply is fed by gravity then the supply pressure should be verified to ensure the conditions of use are appropriate for the valve.

The range of available temperature adjustment is 35°C to 48°C **BUT** the mixed water temperature at the terminal fitting should never be set to a temperature that exceeds the maximum set outlet temperature for the application.

COMMISSIONING

The valve must be commissioned under normal site system conditions and after establishing supply conditions with the hot and cold water supplies open, leave the system running to allow temperatures and pressures to stabilise and be checked.

Prior to commencing commissioning, the following checks should be carried out.

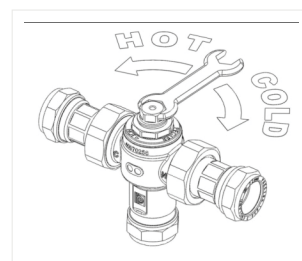

- ▶ The designation of the thermostatic mixing valve matches the application.
- ▶ The supply pressures and temperatures are within the operating range of the valve.
- ▶ Isolating valves and strainers are provided.
- ▶ The supply temperatures are within the range permitted for the valve and by guidance information on the prevention of legionella etc.

If all these conditions are met, proceed to set the temperature as described below. The Pegler Yorkshire model P405 thermostatic mixing valve is supplied factory set at 43°C but the valve may be simply adjusted after installation.

The mixed water temperature at the terminal fitting must never exceed the maximum temperature setting for the particular application (See Table 2). Note, it is not possible to install one thermostatic mixing valve to supply two differing applications unless the temperature of the higher setting is limited to that of the lower application.

WASHWALL THERMOSTATIC MIXING VALVE

- ▶ Remove the plastic cap on top of the valve with the supplied Allen key or other suitable tool.
- ▶ Using a close fitting spanner, reduce the mixed outlet temperature by turning clockwise.
- ▶ Increase the mixed water outlet temperature by turning counter clockwise.

When the valve has been installed with the correct conditions of use it is advised that the valve is subjected to exercise prior to the commissioning at the application temperature. With hot and cold water flowing through the valve, operate the valve from full cold to full hot at least three times.

With the valve at the full cold position bring the valve to the correct application temperature by turning the spanner counter clockwise. If the valve overshoots this temperature, return the valve to the full cold condition, and reset it to the correct temperature $\pm 0.2^{\circ}\text{C}$. Do not set a valve on a lowered temperature as this will not provide consistent operation.


When the valve is set to the required temperature for the application carry out 5 cold water isolation tests to further exercise the valve.

COMMISSIONING TEST SEQUENCE

After adjusting the temperature of the mixed water in accordance with the valve application (see Table 2), carry out the following sequence:

1. Record the temperature of the hot and cold water supplies.
2. Record the temperature of the mixed water at the largest draw-off flow rate.
3. Record the temperature of the mixed water flow at a smaller draw-off flow rate, which shall be measured.
4. Isolate the cold supply to the mixing valve and monitor the mixed water temperature recording the maximum temperature achieved and the final stabilised temperature.
5. Record the equipment, thermometer etc. used for the measurements.

NOTE



The final stabilised temperature should not exceed the values in Table 3.

After correct commissioning secure the protective blue TMV3 cap using the supplied screw ensuring that the blue colour TMV3 cap is fitted; this will indicate the valve has been commissioned to the TMV3 standard.

WASHWALL THERMOSTATIC MIXING VALVE

IN-SERVICE TESTING

The purpose of in-service testing is to regularly monitor and record the performance of the thermostatic mixing valve. Deterioration in performance can indicate the need for service work on the valve and/or water supplies.

Carry out the test sequence detailed below using the same or equivalent equipment as used for commissioning the valve.

- ▶ Check the designation of the thermostatic valve matches the application.
- ▶ Check that the supply pressures and temperatures are within the operating range of the valve.
- ▶ Check that the supply temperatures are within the range permitted for the valve and by guidance information on the prevention of legionella etc.
- ▶ Check there have been no significant changes in inlet supply temperatures and pressures since commissioning or the previous in-service test.

If significant changes have occurred it is recommended to re-commission the valve.

If the mixed water temperature has changed significantly from the previous test results (e.g. $>1^{\circ}\text{C}$), record the change and before re-adjusting the mixed water temperature carry out the following checks:

- ▶ All in-line or integral strainers are clean.
- ▶ Any in-line or integral non-return valves or other anti-backsiphonage devices are in good working order.
- ▶ Any isolation valves are fully open.

With an acceptable mixed water temperature complete the commissioning test sequence detailed above. If the final mixed water temperature is greater than the values in Table 3 and/or the maximum temperature exceeds the corresponding value from the previous test results by more than about 2°C the need for service work is indicated (see TMV servicing and cleaning instructions).

In-service tests should be carried out with a frequency which identifies a need for service work before an unsafe water temperature can result.

WASHWALL THERMOSTATIC MIXING VALVE

FREQUENCY OF IN-SERVICE TESTING

6 to 8 weeks after commissioning carry out the test sequence detailed above. 12 to 15 weeks after commissioning carry out the test sequence detailed above. Depending on the results obtained, the following course of actions must be followed:

- ▶ If no significant changes (e.g. $<1^{\circ}\text{C}$) in mixed water temperature are recorded between commissioning and testing at 6 to 8 weeks, or between commissioning and testing at 12 to 15 weeks, the next in-service test can be deferred to 24 to 28 weeks after commissioning.
- ▶ If small changes (e.g. 1 to 2°C) in mixed water temperature are recorded in only one of these periods, necessitating adjustment of the mixed water temperature, then the next in-service test can be deferred to 24 to 28 weeks after commissioning.
- ▶ If small changes (e.g. 1 to 2°C) in mixed water temperature are recorded in both of these periods, necessitating adjustment of the mixed water temperature, then the next in-service test should be carried out at 18 to 21 weeks after commissioning.
- ▶ If significant changes (e.g. $>2^{\circ}\text{C}$) in mixed water temperature are recorded in both of these periods, necessitating service work, then the next in-service test should be carried out at 18 to 21 weeks after commissioning.

The general principle to be observed after the first 2 or 3 in-service tests is that the intervals of future tests should be set to those which previous tests have shown can be achieved with no more than a small change in mixed water temperature. It is recommended that in-service tests are carried out once every 6 months as a minimum.

NOTE

If there is a residual flow during the commissioning or in-service test during the cold water supply isolation test then this is acceptable providing the temperature of the water seeping from the valve is no more than 2°C above the designated maximum mixed water outlet temperature setting of the valve as defined in Table 2.

Temperature readings should be taken at the normal flow rate after allowing the system to stabilise. The sensing part of the thermometer probe must be fully submerged in the water that is to be tested. Any TMV that has been adjusted or serviced must be re-commissioned and re-tested in accordance with the manufacturer's instructions.

WASHWALL THERMOSTATIC MIXING VALVE

CLEANING AND SERVICING

Most domestic water supplies contain calcium which will separate out when the water is heated in a system. The degree and speed of scaling may vary depending on factors such as water flow rates, system design, the hardness of the water and the temperature to which the water is heated. Deposits of scale may over time form in the valve, particularly at the hot inlet. The formation of the scale may adversely affect the performance of the valve which will be detected during the in-service testing. If this occurs it will be necessary to remove the valve for de-scaling and servicing.

- ▶ Isolate the hot and cold supply.
- ▶ Remove the valve to a clean working area.
- ▶ Remove the protective cap.
- ▶ Unscrew the headwork of the valve.
- ▶ Carefully remove the element and valve assembly and put to one side.
- ▶ Remove the main spring and flow guide and carefully put to one side.
- ▶ Inspect the components for contamination or damage.
- ▶ Clean or replace as necessary.
- ▶ Remove the two o-rings.
- ▶ Clean the valve body and headwork using a proprietary de-scaler.
- ▶ Thoroughly rinse the body and headwork in clean water.
- ▶ Carefully fit new o-rings from the service kit taking care to ensure they are not damaged and are correctly located.
- ▶ Lubricate the o-rings with the lubricant provided.
- ▶ Re-fit the flow guide and spring, lubricating the flow guide around the greatest diameter with the lubricant provided.
- ▶ Lubricate the shuttle valve with the lubricant provided.
- ▶ Re-fit the shuttle valve and element assembly.
- ▶ Re-fit the headwork ensuring correct tightening.
- ▶ Re-fit the valve assembly.
- ▶ If after cleaning the valve, and replacing the o-ring seals, the valve does not function correctly, it may be necessary to replace the thermal element.

WASHWALL THERMOSTATIC MIXING VALVE

SPARES

Ref	Spare part order code	Description
A-1	854550	Blue TMV3 protective cap complete with screw
A-2	854551	White TMV2 protective cap complete with screw
B	854447	Hexagon key
C	854454	Service kit
D	854449 (15mm), 854450 (22mm)	Tailpiece strainer kit
F	854456 (15mm), 854457 (22mm)	Sealing washer
G	854455 (15mm), 817012 (22mm)	Wafer strainer

WASHWALL WATER SERVICE VALVES AND FILTERS

DEFINITION

Dolphin WashWall incorporates water service valves at the water inlets. They combine the following functions:

- ▶ A quarter-turn isolation ball valve, WRc certified for reliability, with slotted or handle operation.
- ▶ Strainer/filter that is easy to check/remove via the port as shown. It strains/filters all water to the Dolphin WashWall system, simplifying the O&M process.
- ▶ A port giving side access to the strainer/filter and ball valve while the system is under pressure, without draining down or breaking the pipework.



Regular checks of the strainer/filter are recommended. To check / remove / replace / clean the strainer/filter simply shut the ball valve, remove the screw cover plate and access the strainer/filter. Reverse the process to re-open the valve.

Brass bodied valve with 15mm or 22mm copper connection · Isolation ball valve with slotted or handle control · Screw plate cover · Strainer/filter



WASHWALL HAND DRYER UNIT

TECHNICAL DATA

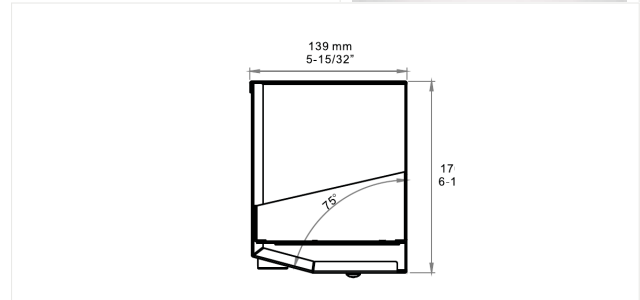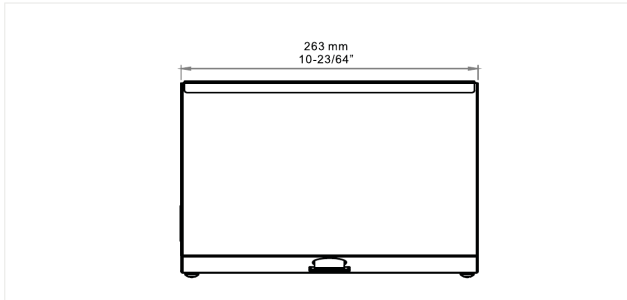

Item category	Performance
Operating voltage	220-240 Vac, 50/60 Hz, 0.84-1.0kW
Air output temperature	55°C (131°F) – ambient temp 25°C (77°F)
Air volume	101.7m ³ /h (59.8 CFM)
Motor type	11/16HP, 500w, 29,000 rpm, brush type, dual ball bearings
Motor thermal protection	Auto-resetting thermostat turns unit off at 105°C (221°F)
Heater element	500w
Heater thermal protection	Thermal cut off at 139°C (282°F)
Drying time	Less than 15 seconds
Stand-by power	Less than 0.5w
Circuit operation	Infrared automatic, self adjusting
Sensor range	2" to 10" (51mm to 254mm) auto adjust 7" (18cm ± 2cm)
Timing protection	60 seconds auto shut off

For more detailed instructions on this hand dryer including sensor, heater and airspeed adjustments and instructions on how to change parts, go to BC2003BM on our website: <https://www.dolphinsolutions.co.uk/product/behind-mirror-hand-dryer/>


WASHWALL HAND DRYER UNIT

CLEANING AND MAINTENANCE

Periodic cleaning of the unit is recommended to ensure optimum performance.


- ▶ Isolate the electrical supply.
- ▶ Remove the two cover-mounting screws. Remove the cover.
- ▶ Clean all dust and lint from the interior of the dryer. Wipe the cover with a damp cloth and mild cleaning solution. Do not soak. Never use abrasives to clean the cover.
- ▶ Replace the cover. Do not over-tighten the screws.

- Replace the cover: Do not over tighten the screws.

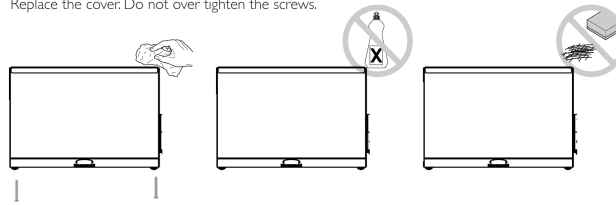

PARTS LIST

Key	Description	Qty
01	Enclosure (casing)	1
02	Security hex screw	2
03	Blower housing (upper)	1
04	Blower housing (below)	1
05	Motor 240vac@500w	1
06	Motor rubber (upper)	1
07	Motor rubber (below)	1
08	Heater assembly 240vac@500w	1
09	Circuit board module (CMB), 220-240vac	1
10	Base plate	1
11	Nylon hole bushing	1
12	Insulation Mylar	1
13	Terminal block	1
14	Blower mounting bracket	1
15	Sensor bracket	1
16	Sensor / Sensor (blue)	1
17	Cable clamp	1
18	Cable protector	1
19	Grounding screw	1
20	Left box bracket	1
21	Right box bracket	1
22	Box	1

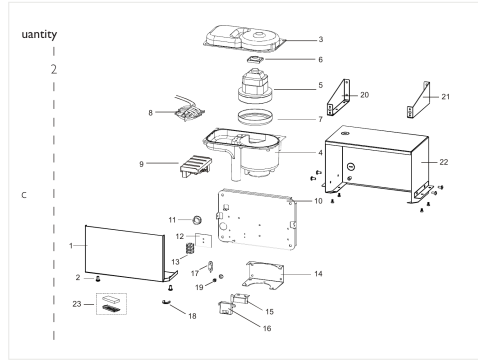

WASHWALL HAND DRYER UNIT

REMOVING AND REFITTING A HAND DRYER




The hand dryer in situ




1. Slide open the fuse holder



2. Remove the plug complete

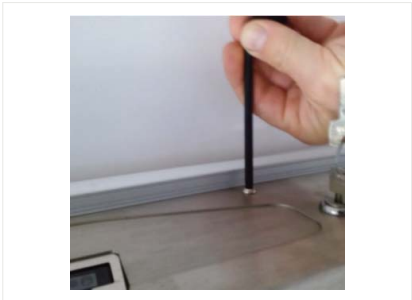

3. Undo the 1st T30V retaining screw

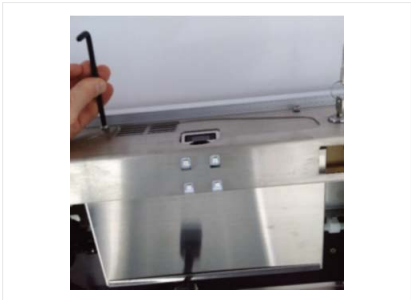


4. Undo the 2nd T30V retaining screw



5. Lift out the dryer unit



The dryer unit with the cover on

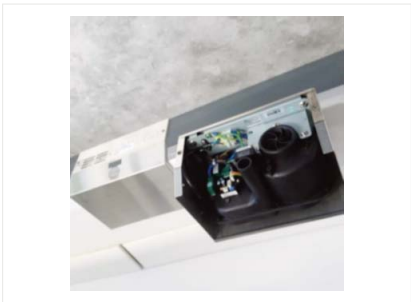

The dryer unit with the cover off



6. Replace the fuse in the holder

To refit a dryer follow steps 1 to 5 above in reverse order.

WASHWALL HAND DRYER UNIT

TROUBLESHOOTING – DIAGNOSTICS AND REMEDIES

Corrective Actions for Initial Installation Failures

Q If the dryer will not run

A First ensure that the breaker supplying the dryer is operational. If it is, disconnect the power and remove the dryer cover. Taking suitable precautions to avoid shock hazard, reconnect the power and check for voltage at the terminal block. Verify that connections are made correctly.

Q The dryer cycles by itself or runs constantly

A Ensure that there is no obstacle on or in front of the infrared sensor. Clean any dirt or debris off the sensor lens. If problems persist replace sensor.

Q The dryer makes a loud noise and does not run for a complete cycle

A Ensure that the supply voltage is correct. The dryer will make a loud humming noise if the input voltage is too high. Verify voltage requirement on unit rating label and correct supply as required. If the CBM has been damaged, replace CBM, infrared sensor module and VR component and cable.

Q The dryer runs but air stream is low pressure and/or low velocity

A Ensure that the supply voltage is correct. The dryer will run weakly if the input voltage is too low. Verify voltage requirement on unit rating label and correct supply as required.

Corrective Actions for In-Service Failures

Q If the dryer will not run

A First ensure that the breaker supplying the dryer is operational. If it is, disconnect the power and remove the dryer cover. Replace the CBM and infrared sensor module. Taking suitable precautions to avoid shock hazard, reconnect the power and check for voltage at the terminal block.

Q The infrared sensor only 'sees' close range objects

A Ensure that there is no obstacle on or in front of the infrared sensor. Clean any dirt or debris off the sensor lens. If problem persists, disconnect the power and remove the dryer cover. Taking suitable precautions to avoid shock hazard, reconnect the power and try carefully adjusting the sensitivity control (yellow shaft in blue box on CBM) to increase the sensing range. If problem persists replace sensor.

Q The heater gets hot but no air stream is produced

A Disconnect the power. Remove the dryer cover and disassemble the blower motor/fan housing. Replace the fan motor.

Q The dryer only blows cold air during a full cycle

A Disconnect the power. Remove the dryer cover and disassemble the blower motor/fan housing. Test the thermostat for open circuit. Check the heater element for signs of burning or breakage. Damaged element must be replaced.

Q The air stream is low pressure and velocity

A Check the output nozzle for obstructions. If none are present, disconnect the power. Remove the dryer cover. Remove any dust/lint build-up from intake vent slots. Disassemble the blower motor/fan housing. Check the motor brushes for worn condition ($\leq 1\text{-}3/16"$ [30mm] graphite remains) and replace them if necessary.

WASHWALL HAND DRYER UNIT

Tap

Q If the tap will not work?

A Firstly, ensure the water supply is on and that all shut-off valves are on, so that the valve position is parallel to the pipe. This includes the valves in the hot loop. If it is, then check the tap is connected to the power supply and make sure all connections are pushed tightly together.

Q The tap is dripping?

A This is normally due to the solenoid which is a serviceable part (see section “WashWall Tap Unit” of this manual). Or it could be either the spring, or there could be something keeping the diaphragm open. If it is still dripping, please contact us and ask for a replacement solenoid.

Q The water flow is poor?

A This could be due to the water pressure in the building; 1 to 3 bar is recommended. If the water pressure is normal, check the solenoid has not been done up too tightly. Or check to make sure the aerator is clean (see section “WashWall Tap Unit” of this manual).

Q Tap self-activating?

A The tap will self-activate if the sensor is too close to the sink, because it picks up a reflection off the surface. You can tilt the sensor slightly so it does not self-activate. The recommended height from the sensor to the sink is 300mm.

Soap Dispenser

Q No soap?

A Firstly, check the power supply is connected; if so, then check the soap dispenser is plugged in. You can check to see if it has power by pressing the grey button on the soap dispenser.

Q You can hear the soap pump but no soap comes out, or it is coming out too thick?

A Check that there is actually soap connected to the pump; if so, make sure it is Dolphin Foaming Soap – any other soap will not work correctly. If it is too thick, clean the compressor (see section “Cleaning the Compressor”). If the soap is wrong, drain it out (see “Clean the Soap Tank”).

WASHWALL SOAP DISPENSER SYSTEM

SOAP TYPE

It is **critical** to the functioning of the soap system on WashWall units that the correct soap is used. The wrong type invalidates the warranty. The correct soap is a foaming type with **water thin consistency**. 'Conventional' thicker pearlescent soaps (for example, 'washing up' liquid consistency) will block the system. We can send a sample if you are unsure. Rather call and check with us than use the wrong soap.


SOAP TANK SYSTEM 2012-2017 (MULTI-MODULE VERSION) — FILL / REFILL AND BLEED



1. Use water thin foaming soap only



2. Remove lid from tank and fill



3. Ensure valve on tank is open



4. Ensure the bleed valve is open at the far left hand end of the units to ensure soap flows through; check for leaks and close valves if any are present



5. Locate the grey override button on each soap dispenser pump housing



6. Depress the grey override button and hold until soap begins to flow

WASHWALL SOAP DISPENSER SYSTEM

SOAP TANK STAND-ALONE SYSTEM 2012-PRESENT — FILL / REFILL AND BLEED



1. Locate the soap tank adjacent to the control box



2. The soap tank with grey override button on pump housing indicated




3. Unscrew the soap tank from the pump housing and lower out, refill and replace



4. Prime pump by locating and depressing the grey button on the pump housing as indicated here until soap flows

WASHWALL SOAP DISPENSER SYSTEM


SOAP REFILL CARTRIDGE SYSTEM 2018–PRESENT — REFILL THE SOAP CARTRIDGE SYSTEM




1. Open mirrors on front of WashWall




2. Locate the white cardboard soap refill box

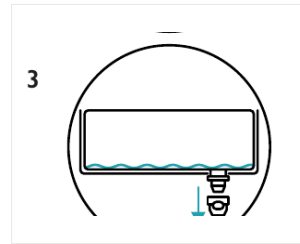


3. Disconnect empty soap refill box by pressing firmly on the button and pulling downwards

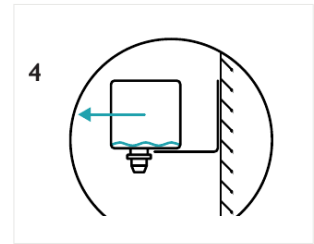


4. Slide empty soap refill box off bracket. Please recycle cardboard box and ramp



5. Pull out spout from inside new soap refill box and slide into bracket

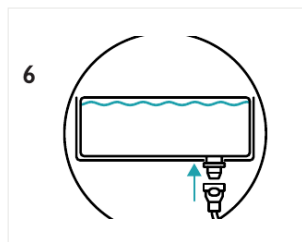

6. Push connector firmly onto refill spout

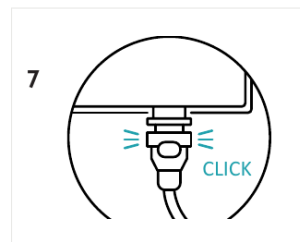

7. Click indicates successful connection

To bleed the soap system, attach the pouch (cartridge) and let it drain through into the reservoir. Then follow steps 4–6 on 'Soap Tank System 2012–2017'. (The first time this is done the reservoir will be filling from empty and will use most of the cartridge in one go. It is recommended that once the reservoir is full, a new full refill cartridge is attached.)


Foaming soap refill cartridges can be ordered online or via the phone: 01424 202224.

WASHWALL SOAP DISPENSER SYSTEM


REMOVING AND REFITTING A SOAP DISPENSER — 12V & 6V VERSIONS · THE 12V VERSION



The 12v soap dispenser in-situ



1. Turn off the soap supply at the tank / reservoir




2. And the same at the opposite end




3. Open the pipe clips at the tee




4. Release the tee




5. Undo the 2 x T20V retaining screws




6. Remove the conduit cover



7. Remove all the dispenser wiring



8. Unplug the soap dispenser



The soap dispenser plug



9. Remove the dispenser




The 12v soap dispenser

To refit a 12v soap dispenser follow steps 1 to 9 above in reverse order.


WASHWALL SOAP DISPENSER SYSTEM

THE 6V VERSION SOAP DISPENSER — GEARBOX ONLY

Remove the soap pump as per steps 1 to 4 at the start of this section.




5. Push the pump up out of the way




6. Undo the 2 x T20V retaining screws




7. Unplug the gearbox from trunking...



7. ...or from the cable (later design)




8. Lift out the gearbox



Close the pipe clips



Refit the cover to the conduit



Turn the soap valves back on


To refit a 6v gearbox follow steps 5 to 8 above in reverse order.

Note — If no soap dispensers or taps work in a whole run, check that the cleaner's switch is not mistakenly left on. For detail on the cleaner's switch and how to operate it, see the "WashWall Cleaner's Switch" section.

WASHWALL SOAP DISPENSER SYSTEM

THE 6V VERSION SOAP DISPENSER — PUMP ONLY

Turn off soap valves at the tank/reservoir and at the vent pipe.

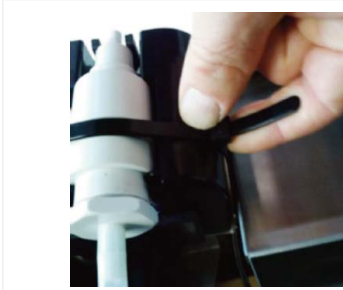

3. Undo cable tie restraining pump




4. Remove pump from gearbox



5. Disconnect pump from tee



6. Turn tee up to retain soap

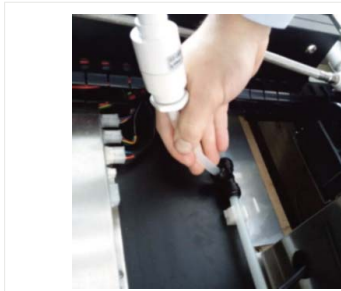

7. Push new pump firmly into tee




8. Fit new pump into gearbox


To complete the refit of a soap pump follow steps 3 & 4 above in reverse order.

CLEANING THE COMPRESSOR (FOAM DISPENSERS)

Dolphin foam soap dispensers include a mesh filter inside the compressor which should be regularly cleaned with warm water. It is recommended to clean the mesh tubing every six (6) months as a minimum, and after periods of non-use, to avoid a decrease in soap volume due to clogging by soap and debris. The mesh tubing should be rinsed with warm water and reassembled on the compressor. The following steps show how it is done.

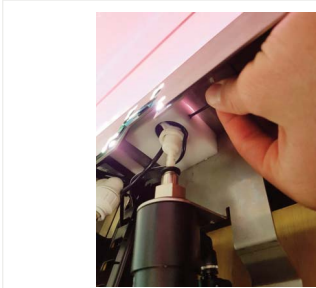

1. First undo the grub screw which holds the sensor in place

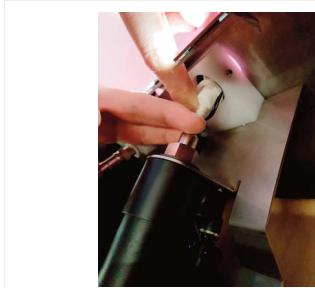



2. Then remove the clear tube from the compressor




3. Then with a spanner undo the nut



4. Then remove the mesh filter from the bottom of the compressor

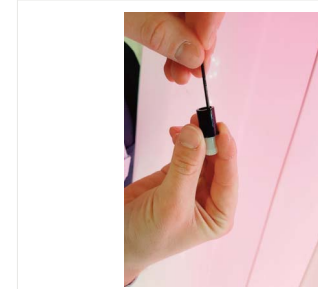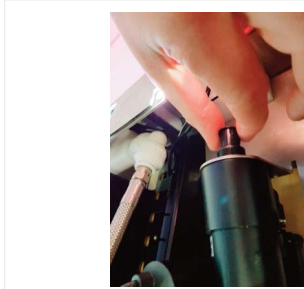


5. Push the white filter out of the black surround

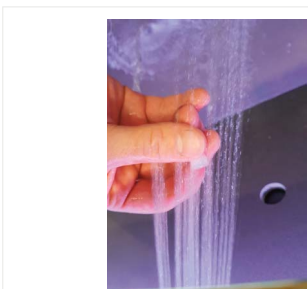


6. Clean with warm water, and then reassemble

CLEAN THE SOAP TANK

Clean out the tank every month by flushing warm water through the hoses and pump until clean water is released from the spout. (Not needed if you have the 2018–present Soap Pouch System.)




1. First turn the shut-off valve perpendicular to the pipe




2. Then release the pipe clips which hold the vent pipe



3. Pull the pipe out of the clips and direct it into the sink




4. Then turn the shut-off valve horizontal to the pipe which will allow the soap to flow out



5. Then fill the soap tank up with water and flush it through the pipes



6. Whilst the water is flushing through, locate the grey primer button on the soap dispenser and hold it down for a minute (repeat for all soap dispensers)




7. Once completed, put the vent pipe back and fill the soap tank up with Dolphin foaming soap (ensure the shut-off valve is in a horizontal position)

WASHWALL TAP UNIT

ADJUSTING THE WATERSPRAY ANGLE



Tap unit seen from beneath with flap open

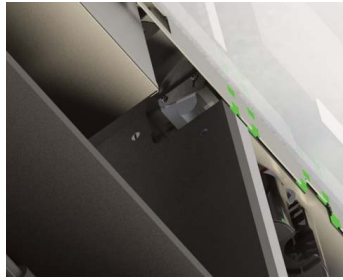

Tap unit seen from above with flap open



Torx TX20 screws



Fig 1 — Tap unit with spray vertical




Fig 2 — Tap unit with spray at maximum angle forward

To adjust the angle of water spray, simply:


1. Loosen both screws with a TX20 screwdriver as shown in Fig 1.
2. Adjust up or down until the desired angle is reached.
3. Tighten screws.

WASHWALL TAP UNIT


CHANGING THE AERATOR

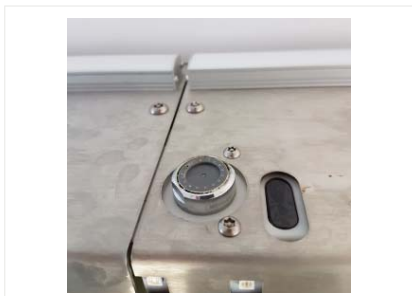


1. Locate the aerator

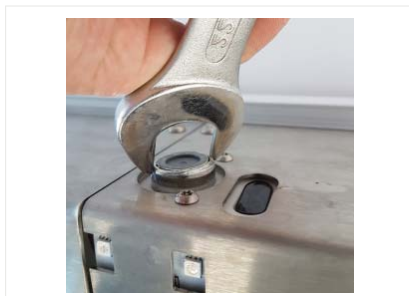


2. Use a 22mm spanner to undo the collar (anti-clockwise to undo)

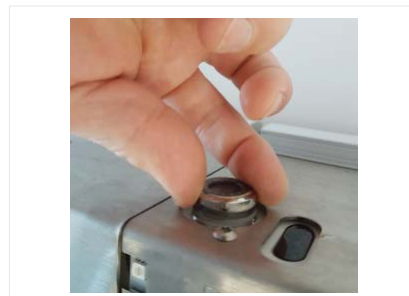


3. Remove finally with your hands

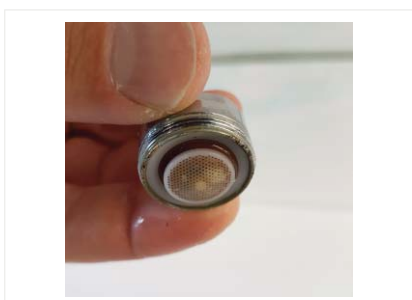

4. A new aerator and housing

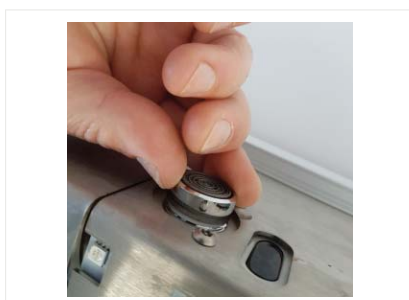

5. Fit the new aerator. **MAKE SURE** the rubber washer is in place between the aerator and the tap body

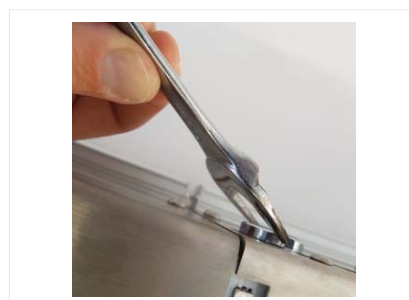

6. Tighten with a ½ turn – **DON'T** overtighten as the housing material is acetal plastic and easily stripped

WASHWALL TAP UNIT


REMOVE A TAP SOLENOID AND CLEAN




1. Isolate the water supply locally



2. Unplug the solenoid



3. Unscrew the solenoid from body



Solenoid clear of body



4. Check diaphragm for particles



5. Clean with water or replace

Refit solenoid as steps 1 to 3 above in reverse order.


WASHWALL TAP UNIT

CHECK / REALIGN SOLENOID INTERNAL PARTS (IF TAP DRIPPING / CONTINUOUSLY RUNNING AFTER CLEAN)

Remove the tap solenoid as steps 1 to 3 on the previous page.



4. Remove diaphragm from solenoid

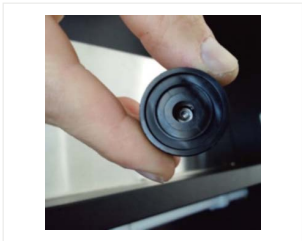


Spring fallen onto its side




5. Remove pin and check spring



6. Remove the spring

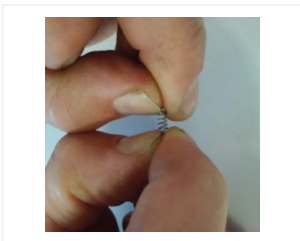

7. Catch 2 coils & stretch spring slightly

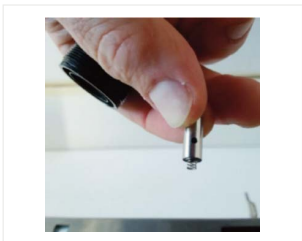

8. Replace spring in pin, holding solenoid up



9. Refit diaphragm



Solenoid complete

Complete: refit solenoid as steps 1 to 3 in reverse order.

WASHWALL LIGHTING COLOUR CONTROL

ADJUSTING THE PERIMETER (HALO / SIDE) AND ICON LIGHTING COLOUR



1. Open the left hand mirror to access the control box



2. The control box




3. Press Menu on the Lighting Control



4. Press Enter on the Lighting Control – thereafter follow the screen prompts. ‘Enter’ allows you to adjust the lighting colour in that section (using + and –), ‘Menu’ takes you to the next section

WASHWALL SCREW DETAIL


SECURITY SCREW USED IN BOTTOM PLATE OF WASHWALL TO SECURE FITTINGS

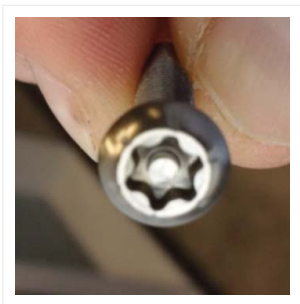


A T20V/T30V pin torx security screw.

WASHWALL LIGHT SENSOR CONTROL

ADJUSTING LIGHT SENSOR CONTROL



1. Locate cleaner's switch and fit key



2. Twist key clockwise to turn on




3. Locate the control box and isolate the power




4. Open control box with the key



5. Control box open showing main PCB



6. Locate blue sensor control on PCB




7. Use slotted screwdriver to adjust

Close the control box, turn the power and cleaner's switch back on and test. Redo steps 1 to 6 if required.


If adjusting the sensor control does not make any improvement it may be that the light sensor board is broken (see the following page for instructions to check).

WASHWALL LIGHT SENSOR BOARD — INSPECTION / REPLACEMENT / TEMPORARY REPAIR / OVER-RIDE

A broken light sensor board will typically result in the lighting working for a few moments after being powered on before it then shuts down.

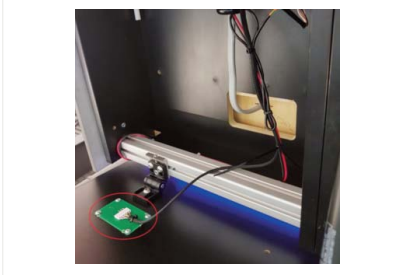


1. Light sensor board circled. This is always on the left hand side of a multi-unit run with the control box, screwed to the underside of the mirror flap with the photocell locating in the circular cut-out. It is plugged into the top of the control board.

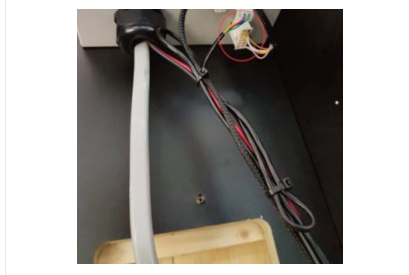


2. Removing the screws allows the sensor board to be removed for inspection. The photocell (circled) can be damaged prior to installation; either or both of the pins that attach to the board may be broken.



3. The occasional problem that can occur is the metal connector pins within the plastic connector housing are not fully pushed in. This shows up by the pins not being a uniform depth at the open end of the housing. This can apply to either connector housing.

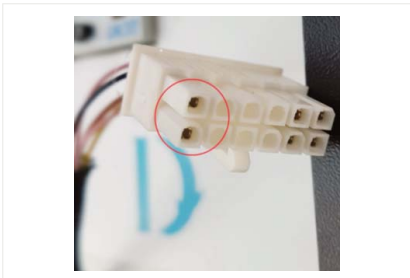

4. If the connectors are OK but the photocell is damaged, the photocell can be bypassed to get the lights working while awaiting a replacement light sensor board.

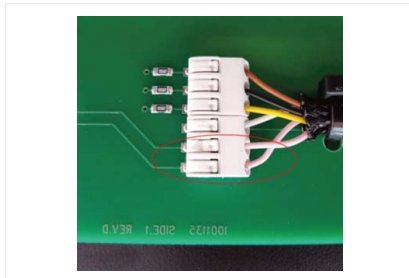


5. The two pink wires can be removed from the light board by depressing the circled terminal connectors with a thumbnail or small screwdriver to release the wires. The exposed wire strands can then be twisted together to make a connection and, if desired, reinserted into one of the terminals.

WASHWALL CLEANER'S SWITCH


OPERATING THE CLEANER'S SWITCH (WHICH DISABLES TAP AND SOAP OPERATION WHEN ON)



1. Locate cleaner's switch and fit key

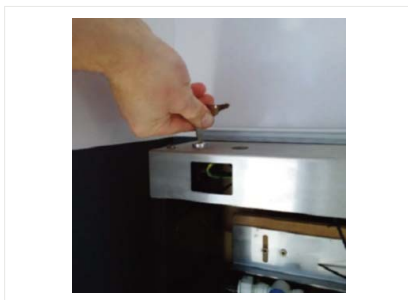

2. Turn key clockwise to turn switch on / anticlockwise to turn switch off

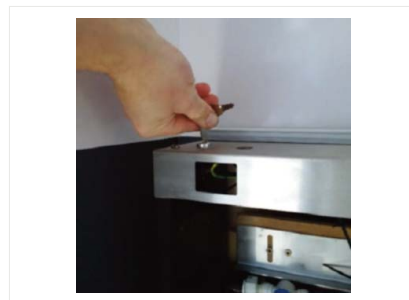

Note — The key will not pull out from the switch while the switch is in the on position.

WASHWALL FUSE CHECKING / RESETTING

If any of the low voltage elements (everything except the hand dryers) are not working it may be necessary to check and reset/replace the fuses.

CHECKING / RESETTING THE FUSES (CURRENT MODEL)




1. Locate the control box and isolate the power



2. Open the control box with the key



3. Locate the PCB on the reverse of the door

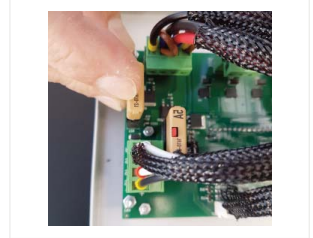


4. Locate and check/reset the fuses


CHECKING / REPLACING THE FUSES (PREVIOUS VERSION)




1. Isolate the power at the RCD as above. Then open the control box to expose the main controller PCB at the back of the control box

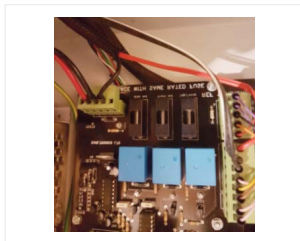

2. Locate the fuses at the bottom of the main controller PCB



3. Remove the fuses one by one by pulling at the back cover – no tools required

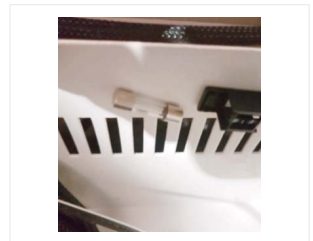


4. Check each fuse – if a fuse has blown the wire will have broken within the glass

To replace fuses simply follow the steps above in reverse order. If fuses continue to break, call our service team to help with identifying the cause.

WASHWALL CONTROL SCREEN SETTING


ADJUSTING THE CONTROL SCREEN CONTRAST (CURRENT MODEL)

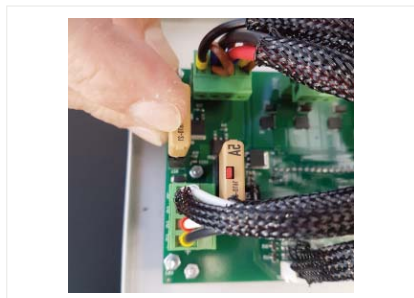


1. Locate the control box and isolate the power




2. Open the control box with the key

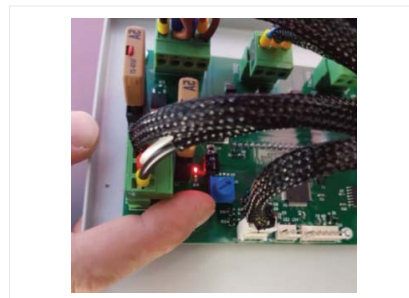


3. Locate the PCB on the reverse of the door

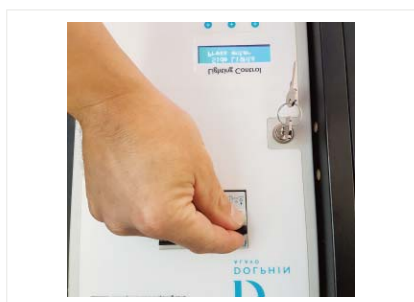

4. Locate and check/reset the fuses

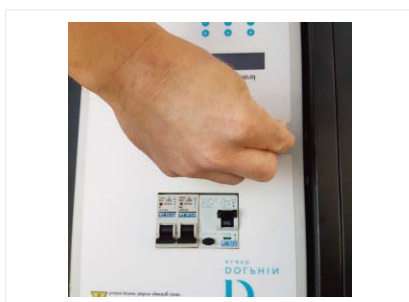

5. Locate the blue potentiometer

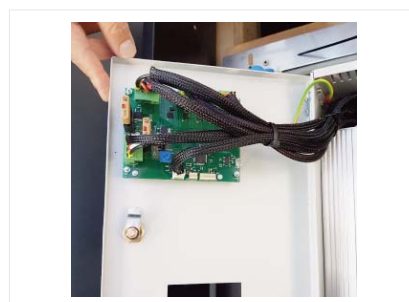

6. Adjust the potentiometer to suit

WASHWALL MIRRORS

IMPORTANT NOTES

As standard, Dolphin WashWall mirrors are Mirox MNGE as manufactured by AGC Glass Europe – see www.yourglass.com for more technical data.

- ▶ The Dolphin WashWall mirrors are coated with glass products for use in interior applications only.
- ▶ For safety applications, the Dolphin WashWall mirror has a safety backing film applied to the painted side of the glass.
- ▶ The Dolphin WashWall mirror can be used in damp environments (kitchens, bathrooms etc.) but should never be immersed in water.
- ▶ The use of safety gloves and appropriate personal protection is strongly recommended during all handling and setting of the glass.

Dolphin WashWall mirrors have a plastic safety film applied to the painted side of the mirror. The film has a triple function:

1. If the glass breaks, the splinters stick to the film, thereby preventing injuries and damage.
2. It protects the paint from scratching.
3. It protects the paint from damp environments.

The safety backing films comply with European EN 12600 safety standards.

WASHWALL MIRRORS

CLEANING AND MAINTENANCE

Glass can get dirty, especially during the construction of a building! But care must be taken when cleaning – it scratches more easily than some might think.

Corrosive contamination must be avoided at all times, especially from plaster, mortar, concrete and cement slurry, all of which are alkaline and therefore capable of corroding the glass surface. Any such impurities must be washed off the glass immediately. Rinse with plenty of clean water to avoid scratching the surface. Use a soft clean sponge, cloth or chamois. Do not try to remove impurities while the glass is dry. Never use sharp objects, such as scrapers, to clean the glass.

To protect the glass during construction, Dolphin recommend covering installed glass with sheets of plastic film. The other teams working on the project should also be informed about handling the glass properly. When cleaning the mirror, the edges must always be dried quickly and thoroughly. Dolphin WashWall mirrors can be cleaned with clean water only.

Important — Never use ammonia-based products or abrasive products (such as anti-limescale products) to clean Dolphin WashWall mirrors.

The Dolphin WashWall mirrors are new-generation ecological mirrors which stand out for:

- ▶ Copper-free metal coating
- ▶ Low level lead paints
- ▶ Resistance to corrosion

WASHWALL GAS STRUTS


REMOVE AND REFIT A GAS STRUT



1. Open and securely prop the flap




Use a strong and secure prop




2. Remove one locking pin



Locking pin removed




3. Remove the other locking pin



Locking pin removed



4. Pop top of strut off the bracket



Support the strut and lower it



5. Pop bottom of strut off the bracket

To refit a strut, follow steps 1 to 5 above in reverse order, ensuring the ball sockets are thread-tight onto the strut first. **Note:** A gas strut must only be used with the thin end at the bottom and the fat end (the cylinder) at the top.

WASHWALL GAS STRUT ADJUSTMENT

ADJUST PRESSURE IN GAS STRUT

To adjust gas pressure, slacken the grub screw in short bursts, and maintain equal pressure between strut pairs.

Note — Test mirror weight repeatedly to ensure sufficient gas remains. Do not over-tighten the grub screw. Release the grub screw in short bursts and with caution.

COMMISSIONING CHECKLIST

Tools & Materials

- | | |
|--|--|
| ☐ Pipe cutters | ☐ Adjustable spanner |
| ☐ Range of screwdrivers | ☐ Water pump pliers |
| ☐ 2mm hex key | ☐ Rags |
| ☐ 2.5mm hex key | ☐ Camera |
| ☐ 5mm hex key | ☐ Foaming soap (not standard liquid soap) |
| ☐ T20 pin torx key | |

Initial Checks

- | | |
|---|--|
| ☐ Mirrors aligned with 3mm gap between each | ☐ If conflict between mirrors, check manual for instructions |
| ☐ Mirrors latch securely when in closed position | ☐ All plumbing connections tight |
| ☐ Open left mirror first | ☐ Soap tubing straight and level across entire unit from tank to vent without undulations |
| ☐ Open each mirror in sequence carefully ensuring no conflict with other mirrors | |

Function Checks

- | | |
|--|---|
| ☐ Ensure basin area completely clear | ☐ All hand dryers activating |
| ☐ Turn on power and water | ☐ Adjust all lighting to colour required |
| ☐ Close mirror flaps | ☐ Adjust light sensor |
| ☐ Ensure all taps discharge once simultaneously | ☐ Soap/paper refill light working |
| ☐ Wait 30 seconds before activating the unit | ☐ Pour foaming soap liquid into the tank (thin watery consistency) |
| ☐ All strip lights and mirror back lights on | ☐ All soap dispensers discharging foam soap when activated |
| ☐ All taps discharging water when activated | |
| ☐ Angle of tap flow correct | |

Final Checks

- | | |
|---|--|
| ☐ Take exterior and interior photos of all units and email to info@dolphinsolutions.co.uk | ☐ Appliance switch — Operation Mode vs Service Mode — Cleaning |
| ☐ Cleaners/facilities staff advised to use foaming soap ONLY | ☐ All baseplates within units dry (if wet with water or soap, a leak is likely) – recheck all pipework and connectors |
| ☐ Cleaners/facilities staff shown how to put unit into cleaning mode with keyswitch | |

For Office Use Only

Project name and location _____

Project reference number _____


Commission complete by _____

Date _____

Further actions (leave blank if none) _____



WASHWALL BEHIND MIRROR SYSTEM

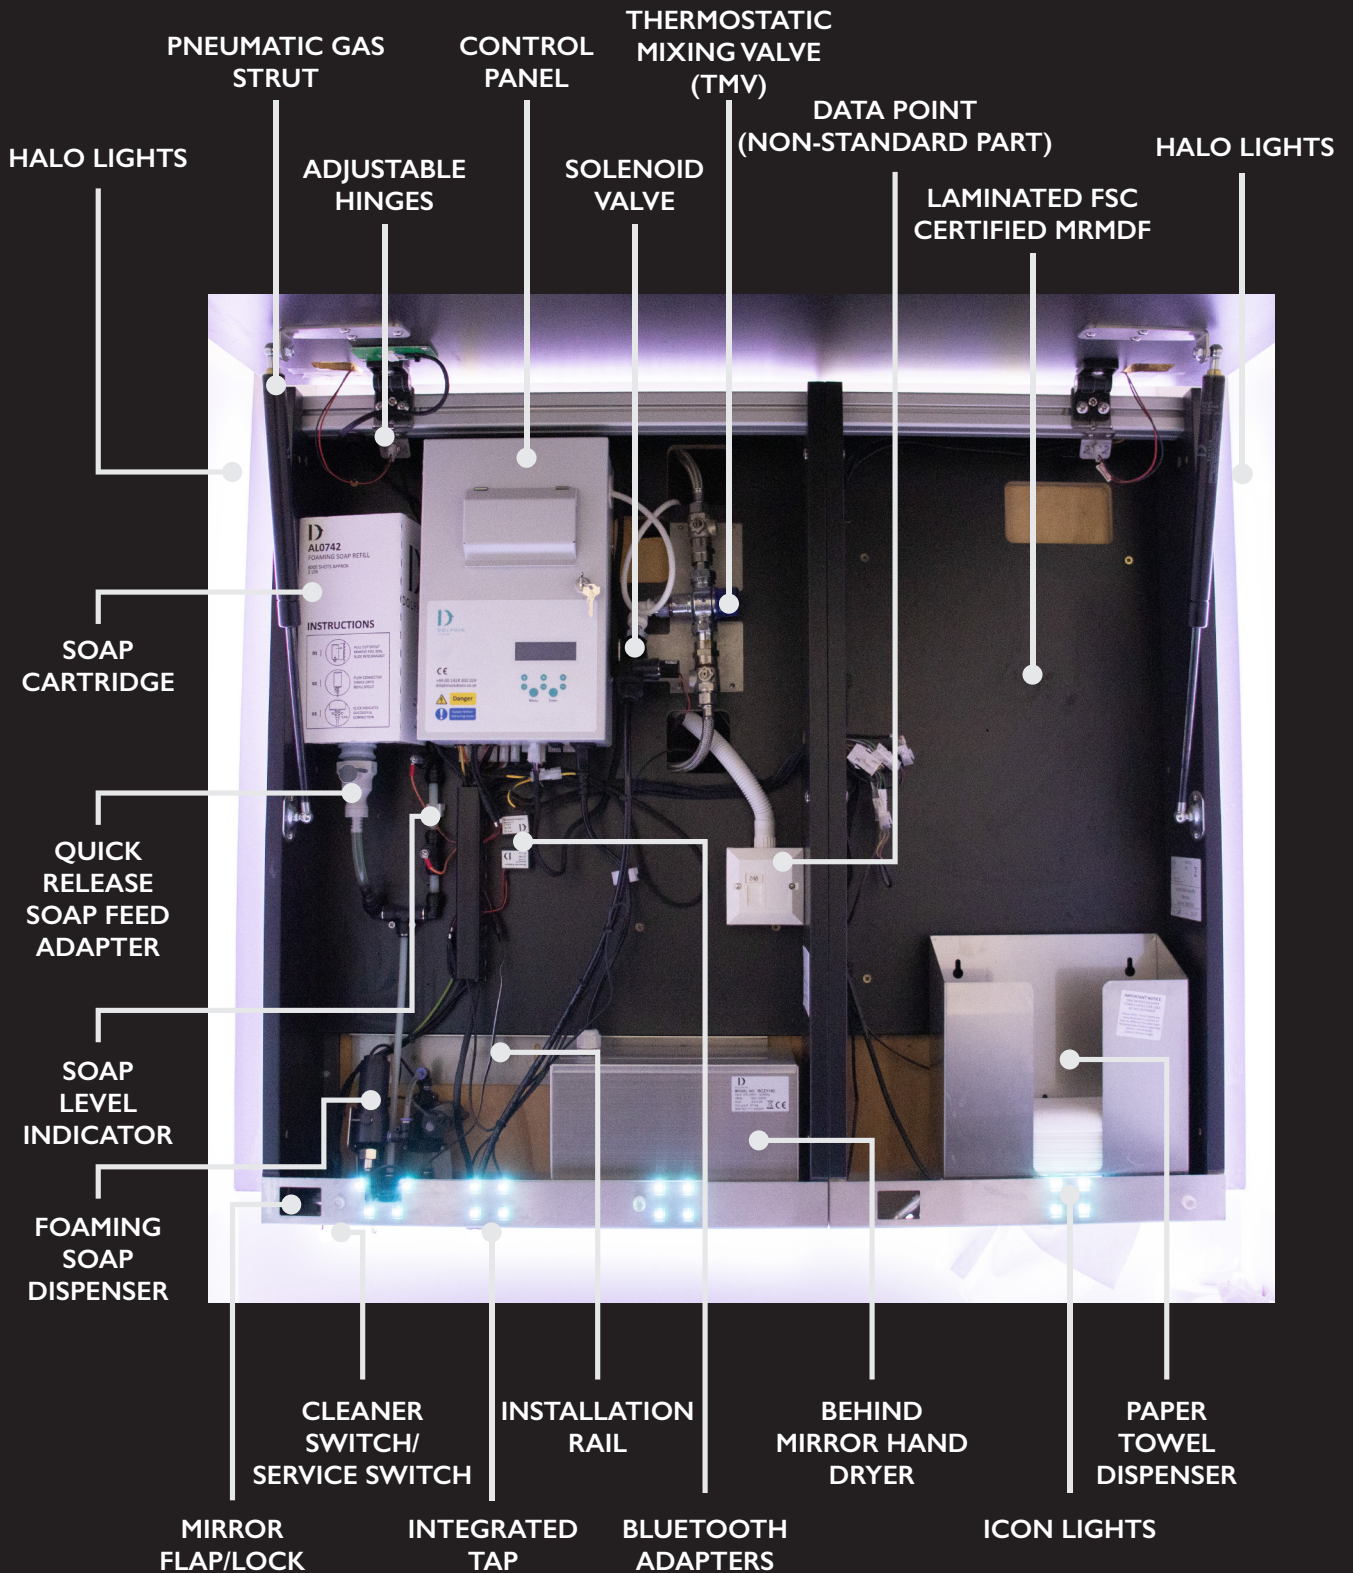

CLEANER'S KEY



INDICATOR LIGHTS

- LOW PAPER TOWEL
- LOW SOAP
- CLEANER'S KEY OFF

SCAN QR CODE TO LEARN HOW TO REPLACE SOAP CARTRIDGE





Dolphin Solutions Ltd

Southpoint, Compass Park, Junction
Road
Bodiam, TN32 5BS,
United Kingdom

T +44 (0)1424 202 224
info.uk@dolphinsolutions.com
dolphinsolutions.com